




PLAN VIEW

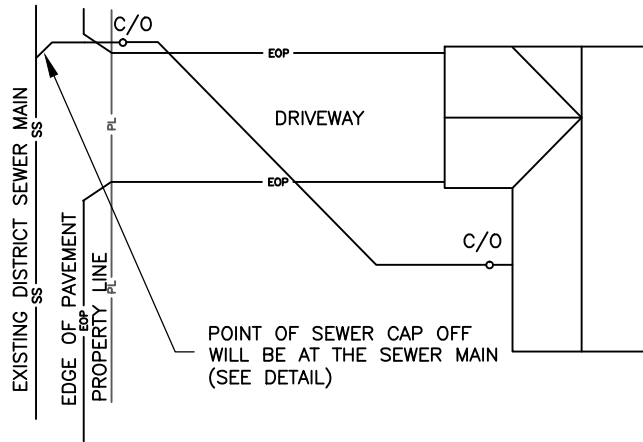

DETAIL

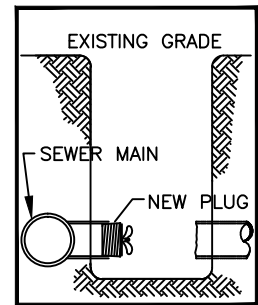

PROFILE VIEW

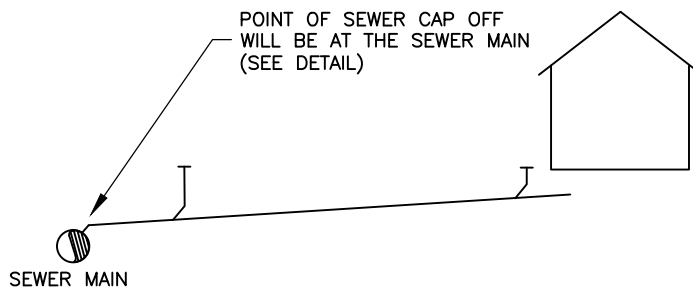

NOTES:

- 1) UNDERGROUND SERVICE ALERT (USA) 811 TO BE NOTIFIED A MINIMUM OF 48 HOURS BEFORE ANY EXCAVATION.
- 2) ALL LATERAL(S) TO BE ABANDONED SHALL BE FIELD MARKED BY DISTRICT INSPECTORS.
- 3) DO NOT DEMOLISH ANY BUILDING UNTIL LATERAL ABANDONMENT LOCATION FOR THAT BUILDING IS EXCAVATED AND CONFIRMED.
- 4) LATERAL(S) WILL BE CAPPED AT THE COLLECTION SYSTEM MAIN. FINAL CAP OFF LOCATION SHALL BE FIELD VERIFIED AND APPROVED BY THE DISTRICT.
- 5) LATERAL(S) MUST BE SEVERED AT THE ABANDONMENT POINT IN A WORKMANSHIP LIKE MANNER APPROPRIATE FOR THE TYPE OF PIPE TO BE CAPPED. A MINIMUM OF SIX FEET (6') OF PIPING UPSTREAM OF THE ABANDONMENT POINT SHALL BE REMOVED.
- 6) THE PLUGGING OF SEVERED LATERAL(S) MUST BE MADE WITH A NEW T-CONE TEST PLUG APPROPRIATE FOR THAT SIZE LATERAL.
- 7) NO WORK SHALL BE COVERED UNTIL INSPECTED AND APPROVED BY THE DISTRICT.
- 8) THE DISTRICT SHALL BE GIVEN A MINIMUM OF A ONE WORKING DAY NOTICE TO INSPECT ALL WORK ASSOCIATED WITH THE CAPPING OF LATERAL(S).

A
1

SEWER LATERAL ABANDONMENT

NO SCALE

DATE: JUL 2016
 SCALE: NO SCALE
 DRAWN: MAM
 FILE: STANDARDS
 SHEET: S7-D11

SEWER DETAILS



SOUTH TAHOE PUBLIC UTILITY DISTRICT

Sewer . 1950 . Water A PUBLIC AGENCY
 1275 Meadow Crest Drive South Lake Tahoe, California 96150
 Phone (530) 544-6474 Fax (530) 541-4319
 WWW.STPUD.US